


2023(令和5)年度2月

騒音・振動測定値報告



工場内配置図

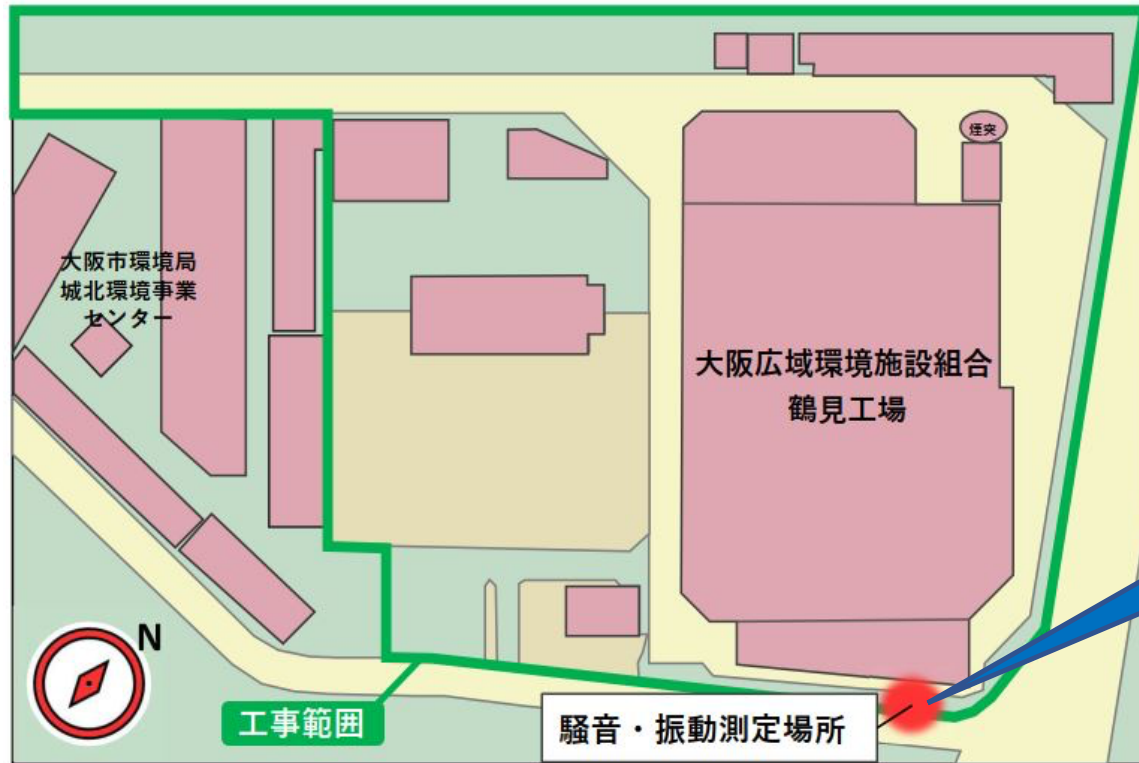

測定項目	規制基準値	2/7(水)		2/14(水)		2/21(水)		2/28(水)	
		10:00 ~ 10:10	15:00 ~ 15:10	10:00 ~ 10:10	15:00 ~ 15:10	10:00 ~ 10:10	15:00 ~ 15:10	10:00 ~ 10:10	15:00 ~ 15:10
騒音L05(dB)	85.0	65.3	65.7	65.3	65.9	67.1	69.2	65.4	64.7
振動L10(dB)	75.0	41.6	39.9	42.6	40.0	41.4	39.9	41.7	41.0