


2024(令和6)年度4月

騒音・振動測定値報告



工場内配置図

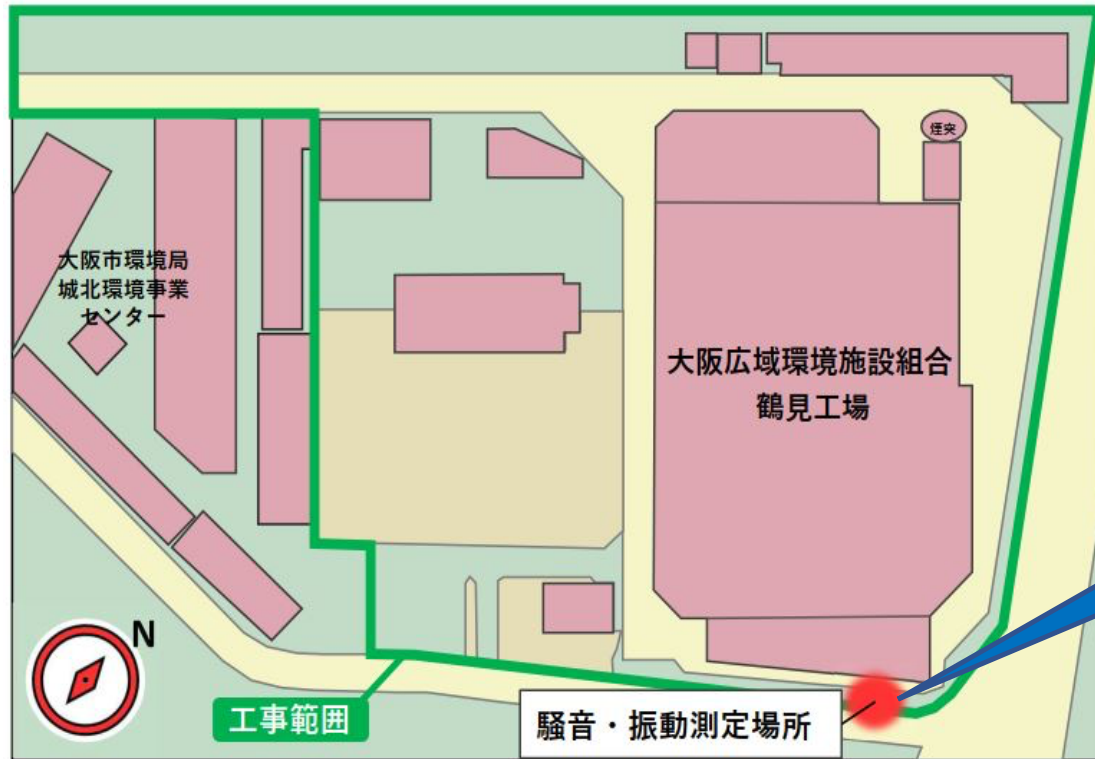

測定項目	規制基準値	4/3(水)		4/10(水)		4/17(水)		4/24(水)	
		10:00 ~ 10:10	15:00 ~ 15:10	10:00 ~ 10:10	15:00 ~ 15:10	10:00 ~ 10:10	15:00 ~ 15:10	10:00 ~ 10:10	15:00 ~ 15:10
騒音L05(dB)	85.0	68.4	69.1	65.6	64.3	66.5	66.5	66.7	67.0
振動L10(dB)	75.0	39.6	39.7	41.0	39.6	42.5	41.3	42.9	41.1